


# ROMEO - REQUEST FORM FOR NON STANDARD JOYSTICK

## Grip type

- Knob (IP 65 assembled in specific enclosure)
- Function
  - Free movement
  - Mechanical interlock + NC/NO contact (not available for proportional Romeo)
  - P1 1NO button
  - Colour of button
    - black
    - green



- Handle (IP 44 assembled in specific enclosure)
- Function
  - Free movement
  - P2 1NO button (for use as electrical interlock)
  - P2 1NO button (for use as electrical interlock) + P3 1NO button
  - Colour of button
    - black
    - green



- Ergonomic handle (IP43 assembled in specific enclosure)




## Movement


- Stepped - spring return
- Stepped - maintained positions
- Linear - spring return

## Lever guide

Standard lever guide

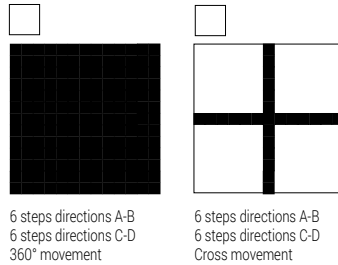


- Customized lever guide (not available for proportional Romeo)



## Joystick label


- Blank label
- Lifting-Traverse symbols
- Trolley-Rotation symbols
- Customized label



Pos. Letterings

1	_____
2	_____
3	_____
4	_____

## Actuators for ergonomic handle

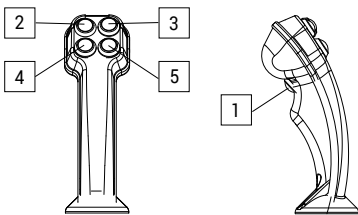

## Actuator type\* and label letterings

Pos.  Yes  No PRVV5080PE Green button 1NO contact + 1 common\*\*

Type	Lettering
2	_____
3	_____
4	_____
5	_____

## Actuators for positions 2-3-4-5

- A PRVV9019PE Green button 1NO contact + 1 common
- B PRVV9020PE Black button 1NO contact + 1 common
- C PRVV0840PE 2 position selector ON-OFF 1 contact + 1 common
- D PRVV0842PE 2 position selector MOM-OFF 1 contact + 1 common
- E PRVV0830PE 2 maintained position selector ON-ON 2 contacts + 1 common
- F PRVV0831PE 3 maintained position selector ON-OFF-ON 2 contacts + 1 common
- G PRVV0832PE 2 position spring return selector ON-MOM 2 contacts + 1 common
- H PRVV0833PE 3 position selector MOM-OFF-MOM 2 contacts + 1 common
- I PRVV0834PE 3 position selector ON-OFF-MOM 2 contacts + 1 common

\* Maximum 5 contacts + 1 common available.  
 Ex.: 1NO contact in position 1 + 4 buttons A type.  
 1NO contact in position 1 + 4 selectors C type.  
 1NO contact in position 1 + 2 selectors G type.

\*\* In case of use of the electrical interlock function, connect it to actuator 1.



Joystick with switches

**Potentiometer**

- 1 PRVV9035PE 2.2 kΩ
- 2 PRVV9020PE 4.7 kΩ
- 3 PRVV9025PE 10 kΩ
- 4 Preset only

**Instructions**


When necessary, write the number corresponding to the potentiometer or to the preset required. Fill in the contact scheme blackening the boxes corresponding to the positions where the cams close the contacts (each bar of 13 boxes correspond to a switch; the central box corresponds to the zero position of the joystick). In the example, the contact is closed in positions 1-2-3 to the left and 3-4 to the right.

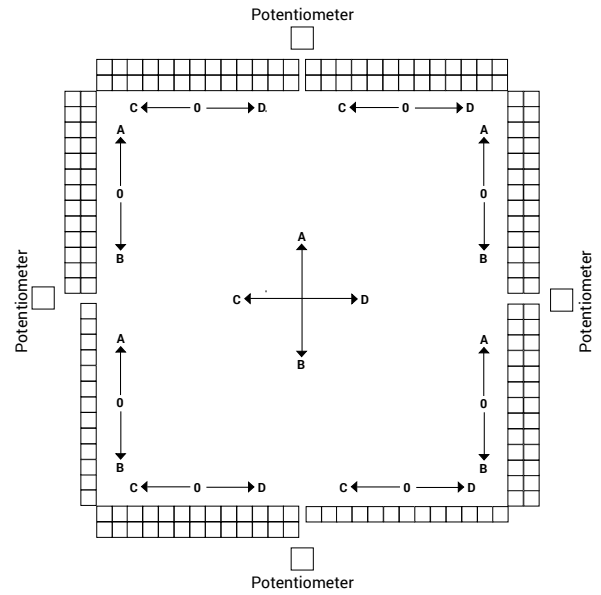

Stepless proportional joystick

**A-B LEVER DIRECTION**

Select the increase / decrease direction of the signal



Standard outputs\*


Standard outputs (A-B direction)			Select a version
Voltage	Current	PWM	
0-10V	4-20mA	0-100%	<input type="checkbox"/>
0-5V	4-12mA	0-50%	<input type="checkbox"/>
0.5-9.5V	4.5-19.5mA	5-95%	<input type="checkbox"/>
0.5-4.5V	4.5-11.5mA	5-45%	<input type="checkbox"/>

Customized outputs

Customized outputs (A-B direction)								
Voltage (from 0 to 10 V)			Current (from 4 to 20 mA)			PWM (from 0 to 100%)		
min	Lever in central position	max	min	Lever in central position	max	min	Lever in central position	max
___V	___V	___V	___mA	___mA	___mA	___%	___%	___%

**C-D LEVER DIRECTION**

Select the increase / decrease direction of the signal



Standard outputs\*

Standard outputs (C-D direction)			Select a version
Voltage	Current	PWM	
0-10V	4-20mA	0-100%	<input type="checkbox"/>
0-5V	4-12mA	0-50%	<input type="checkbox"/>
0.5-9.5V	4.5-19.5mA	5-95%	<input type="checkbox"/>
0.5-4.5V	4.5-11.5mA	5-45%	<input type="checkbox"/>

Customized outputs

Customized outputs (C-D direction)								
Voltage (from 0 to 10 V)			Current (from 4 to 20 mA)			PWM (from 0 to 100%)		
min	Lever in central position	max	min	Lever in central position	max	min	Lever in central position	max
___V	___V	___V	___mA	___mA	___mA	___%	___%	___%

\* Select the standard output required. In case of customized outputs, fill in the 'customized outputs' table paying attention at the value ranges. The value of 'Lever in central position' must be in between the minimum and maximum values chosen.