MIKE-X - REQUEST FORM FOR PENDANT STATION

Protection type

ATEX II 2 G Ex db IIC T6 Gb
II 2 D Ex tb IIIC T85°C Db
IECEx Ex db IIC T6 Gb
Ex tb IIIC T85°C Db

☐ Please, tick the box to accept the protection type provided

Pendant station model

☐ 4 - 8 actuators: simple pendant station

☐ 12 - 16 actuators: double pendant station

Symbols

Optional

☐ Anti-condensation heater

☐ Green start button

☐ Special painting

☐ Connecting bridges

Instructions

- Tick the box to accept the protection type provided.
- Tick the box corresponding to the pendant control station model required: 4 - 8 actuators (simple pendant station), 12 - 16 actuators (double pendant station).
- Enter the number corresponding to the symbol required for each control element.
  If the key selector switch and the emergency pushbutton are required, tick the box corresponding to the right position.
  When the pendant control station is the double row model, complete both the columns.
- **Attention: opposite commands (i.e: up – down) are vertically coupled on columns.**
- Tick the box corresponding to the optional required.

Attention: Only two speeds pushbuttons provided.

Remarks

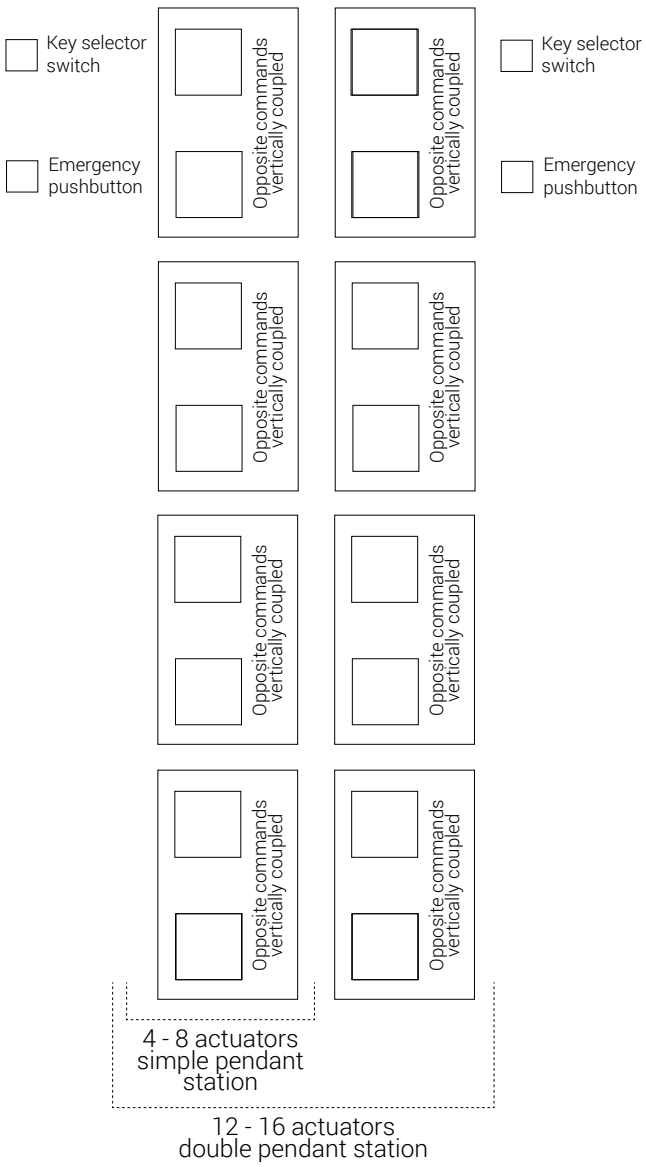

Simple pendant station
4 - 8 actuators

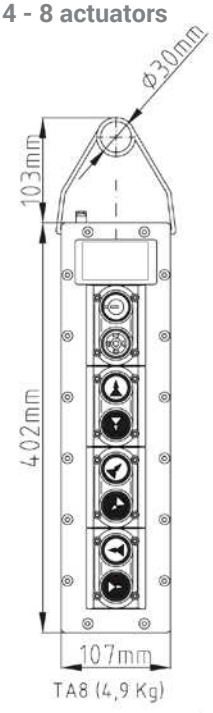
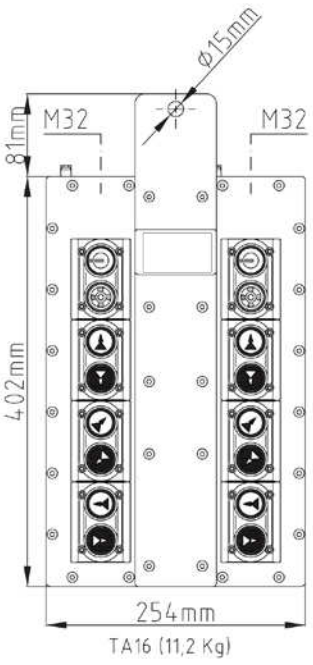
Double pendant station
12 - 16 actuators